


## Fire and Flammability Testing

### NFPA285

Standard Fire Test  
Method for Evaluation  
of Fire Propagation  
Characteristics of  
Exterior Non-Load-  
Bearing Wall Assemblies  
Containing Combustible  
Components

### SCREENING TEST

Narrow Specimen and  
Alternate Burner

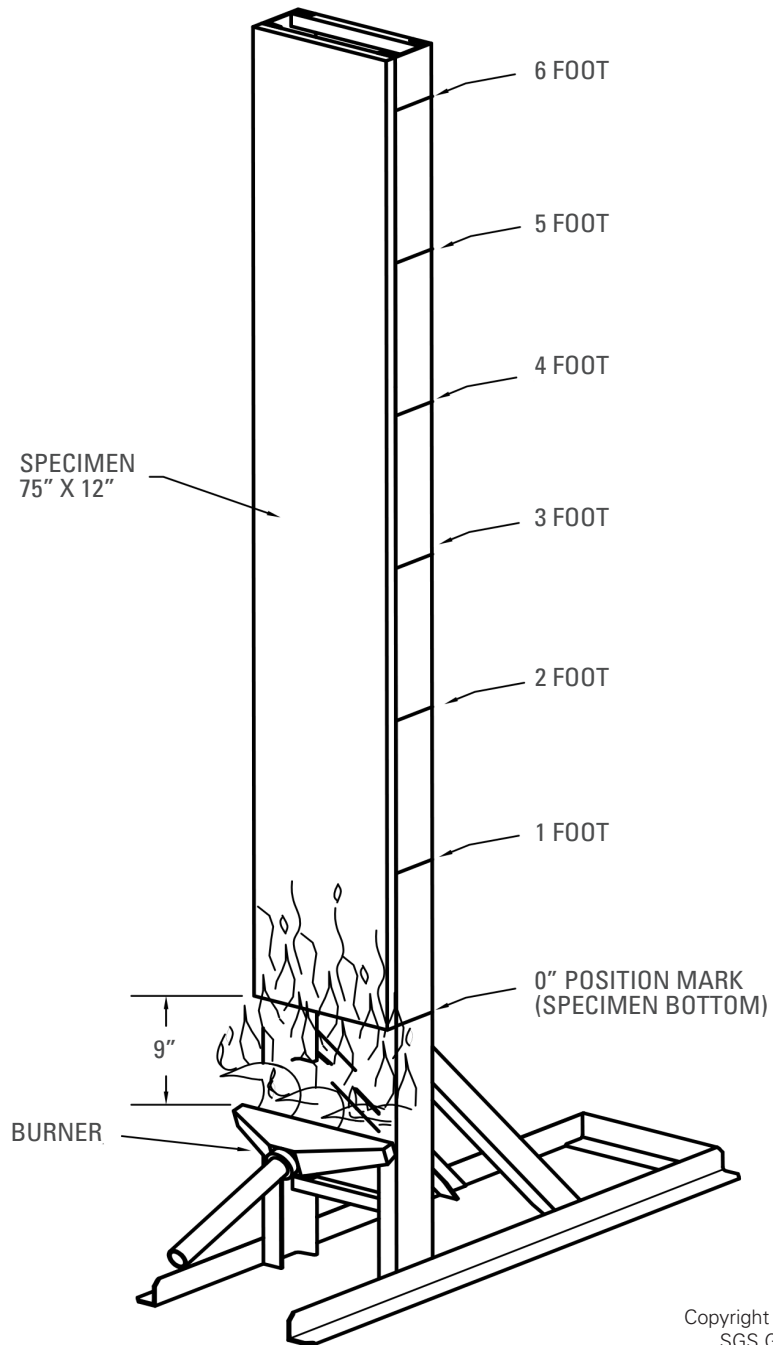


**NFPA285**

Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components

**SCREENING TEST**

Wide Specimen and Standard Burner

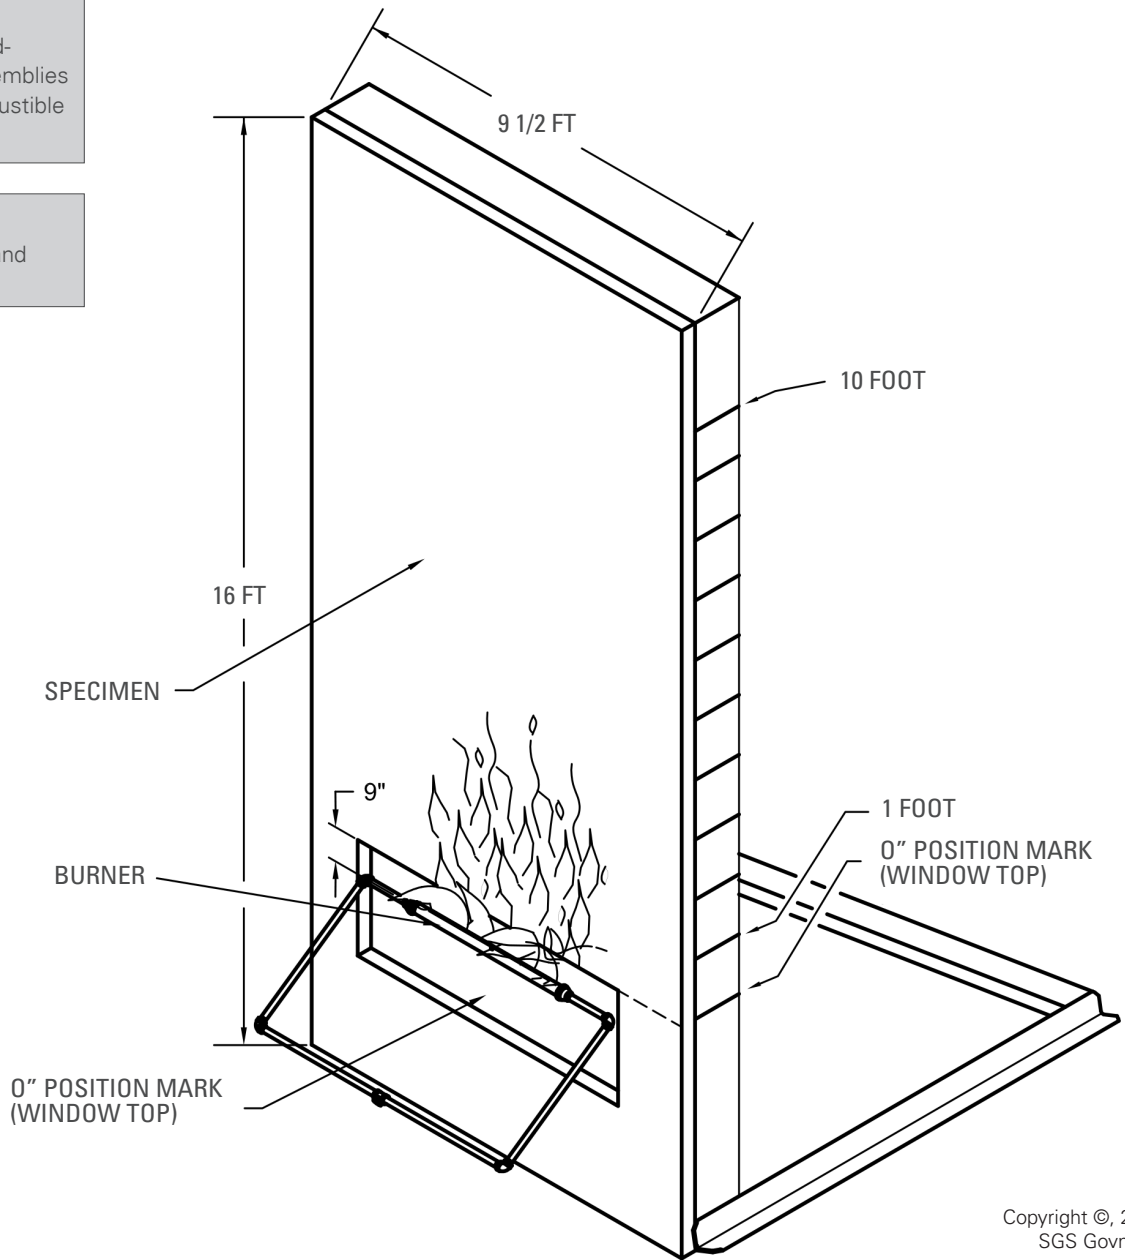

Copyright ©, 2014  
SGS Govmark